


Rough In Diagram

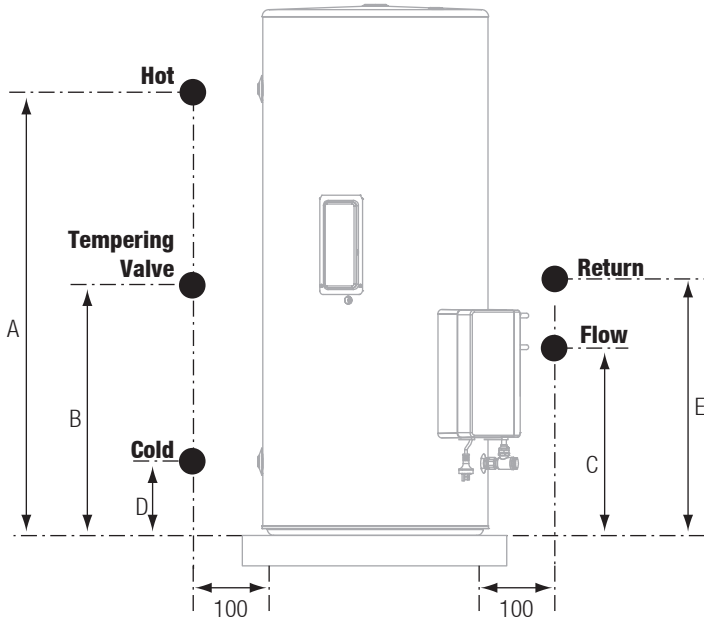

● Approximate location of pipework. A tolerance of 25mm is acceptable to dimensions shown in table below.

Note: Ensure pipes protrude horizontally from wall, and leave enough length of pipe to allow easy connections.

		250 L	315 L	400 L
	Tank Height	1444	1754	1704
	Overall diameter	617	617	705
A	Hot water outlet	1211	1521	1445
B	Tempering Valve	Mid-way between hot and cold pipes		
C	Flow to solar collectors	507	507	531
D	Cold water inlet	195	195	219
E	Return from solar collectors	628	838	642