




Rough-In Diagram

Prodigy 5

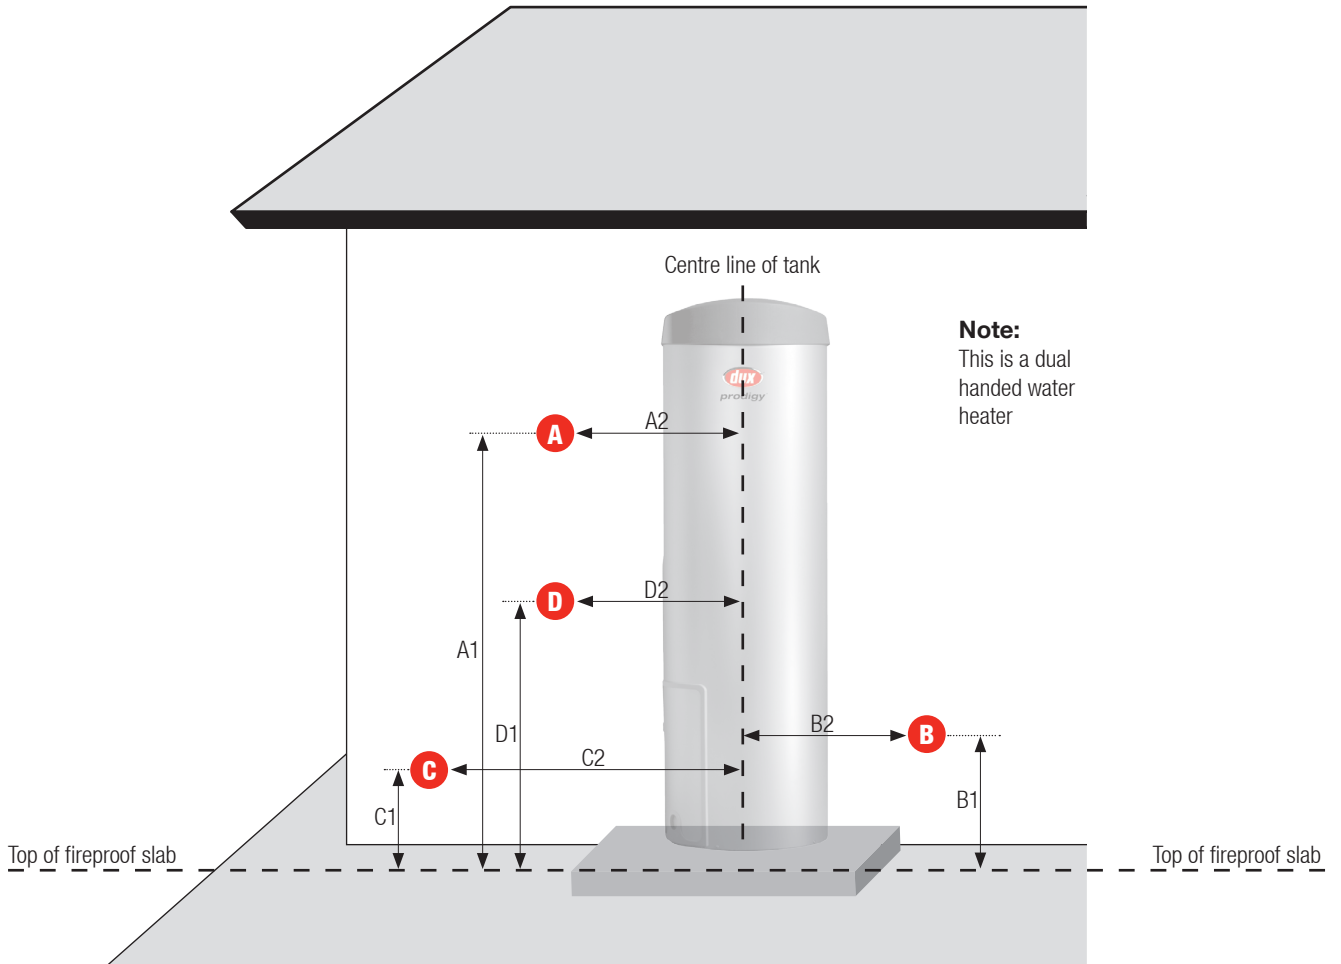

			135 L	170 L
	Tank Height		1732	2045
	Tank Width		530	530
A	Hot water outlet from top of fireproof slab	A1	1370	1680
	Hot water outlet from centre line of tank	A2	370	370
B	Gas entry from top of fireproof slab	B1	340	340
	Gas entry from side of tank	B2	370	370
C	Cold water inlet from top of fireproof slab	C1	260	260
	Cold water inlet from centre line of tank (allowing 300mm for valve train)	C2	570	570
D	Tempered water outlet from top of fireproof slab (mid-way between A1 and C1)	D1	810	970
	Tempered water outlet from centre line of tank	D2	370	370

- Approximate location of pipework (rounded to the nearest 10mm). A tolerance of 25mm is acceptable to dimensions shown in table. Pipes to be left horizontally and protruding a minimum of 350mm. Horizontal dimensions shown in table allow for 100mm pipework from side of tank (i.e. Centreline + (Diameter or Width × 0.5) + 100).